ATTESTATO
DI AVVENUTA PROCEDURA DI SANIFICAZIONE CON SISTEMA OZONO

CONVENTO ACQUA PREMULA
15-16/05/2020

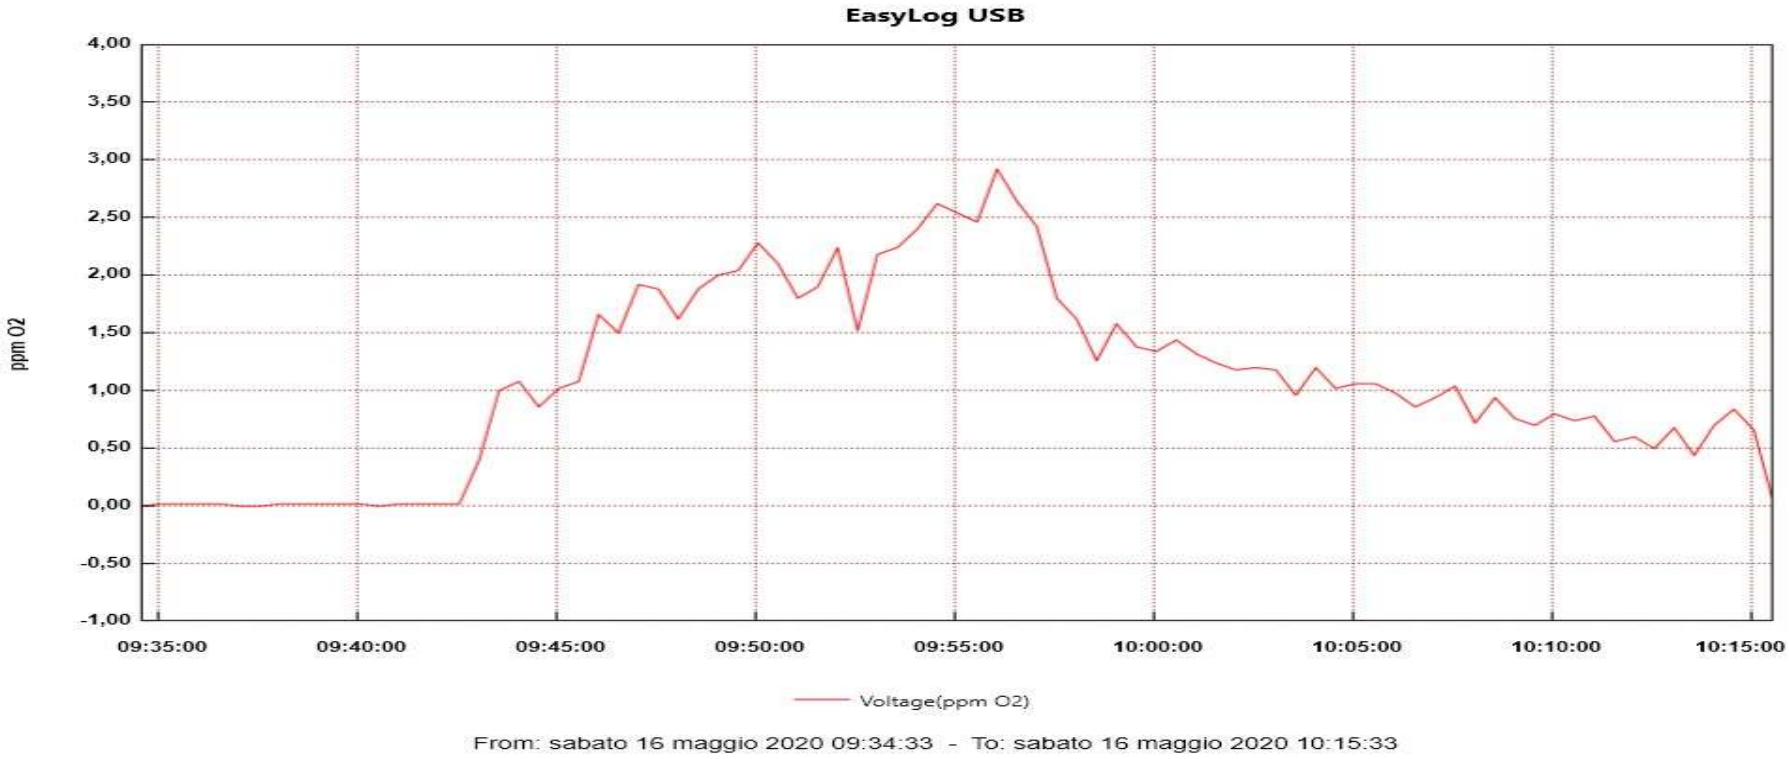

Camera 4

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 09:34:33 16/05/2020
Last Reading 10:15:33 16/05/2020
Elapsed Time 41m, 0s
Total Readings 83

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 09:34:33 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **2,82ppm O2 09:56:03 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,081ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,800ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

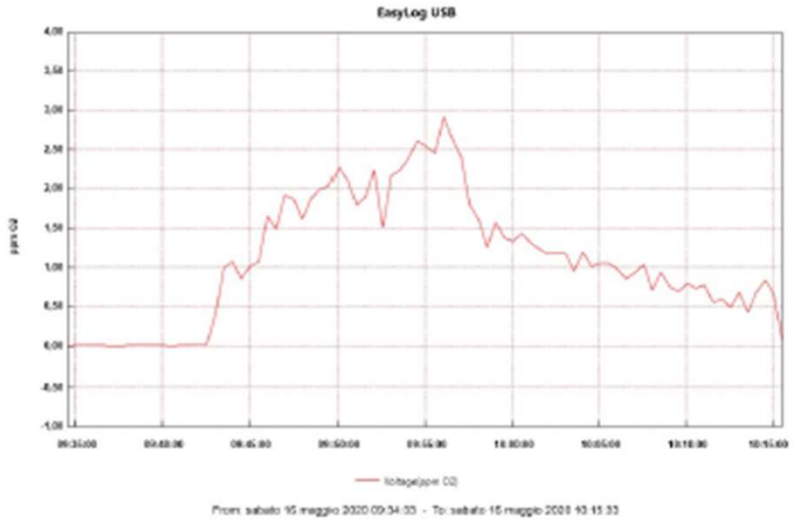

CONVENTO ACQUA PREMULA
15-16/05/2020

Camera 4

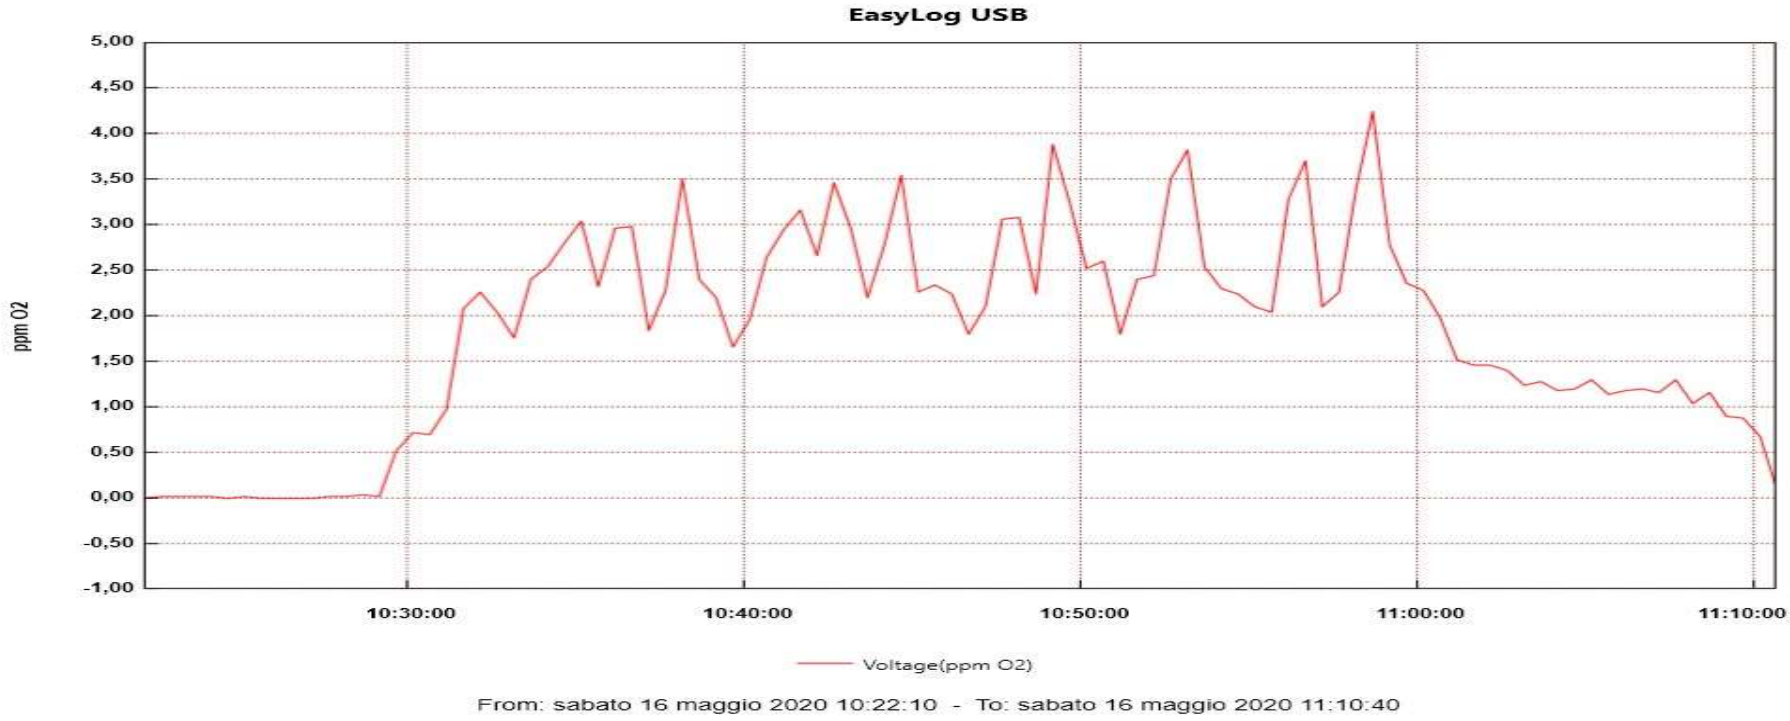

Camera 5

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 10:22:10 16/05/2020
Last Reading 11:10:40 16/05/2020
Elapsed Time 48m, 30s
Total Readings 98

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 10:22:10 16/05/2020**	Alarm Occurrences N/A	Alarm Occurrences N/A
Maximum **4,24ppm O2 10:58:40 16/05/2020**	Total time in alarm N/A	Total time in alarm N/A
Average Reading **1,838ppm O2**	First Alarm Triggered N/A	First Alarm Triggered N/A
Standard Deviation **1,121ppm O2**	Longest Alarm N/A	Longest Alarm N/A

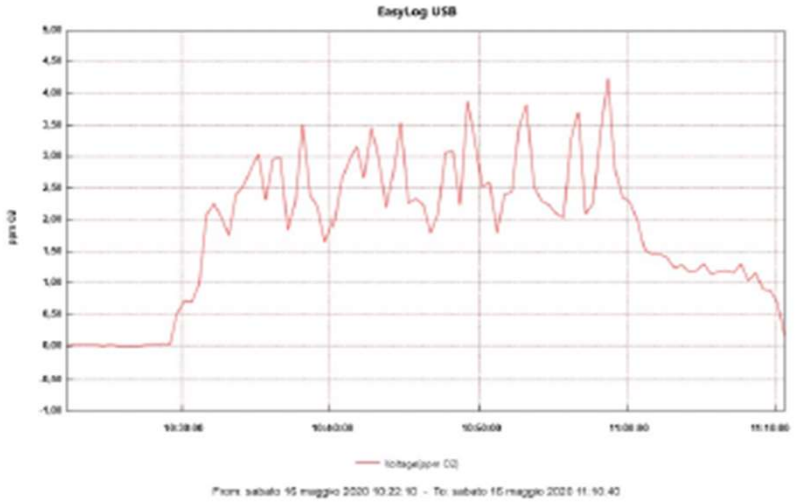

Camera 5

CONVENTO ACQUA PREMULA
15-16/05/2020

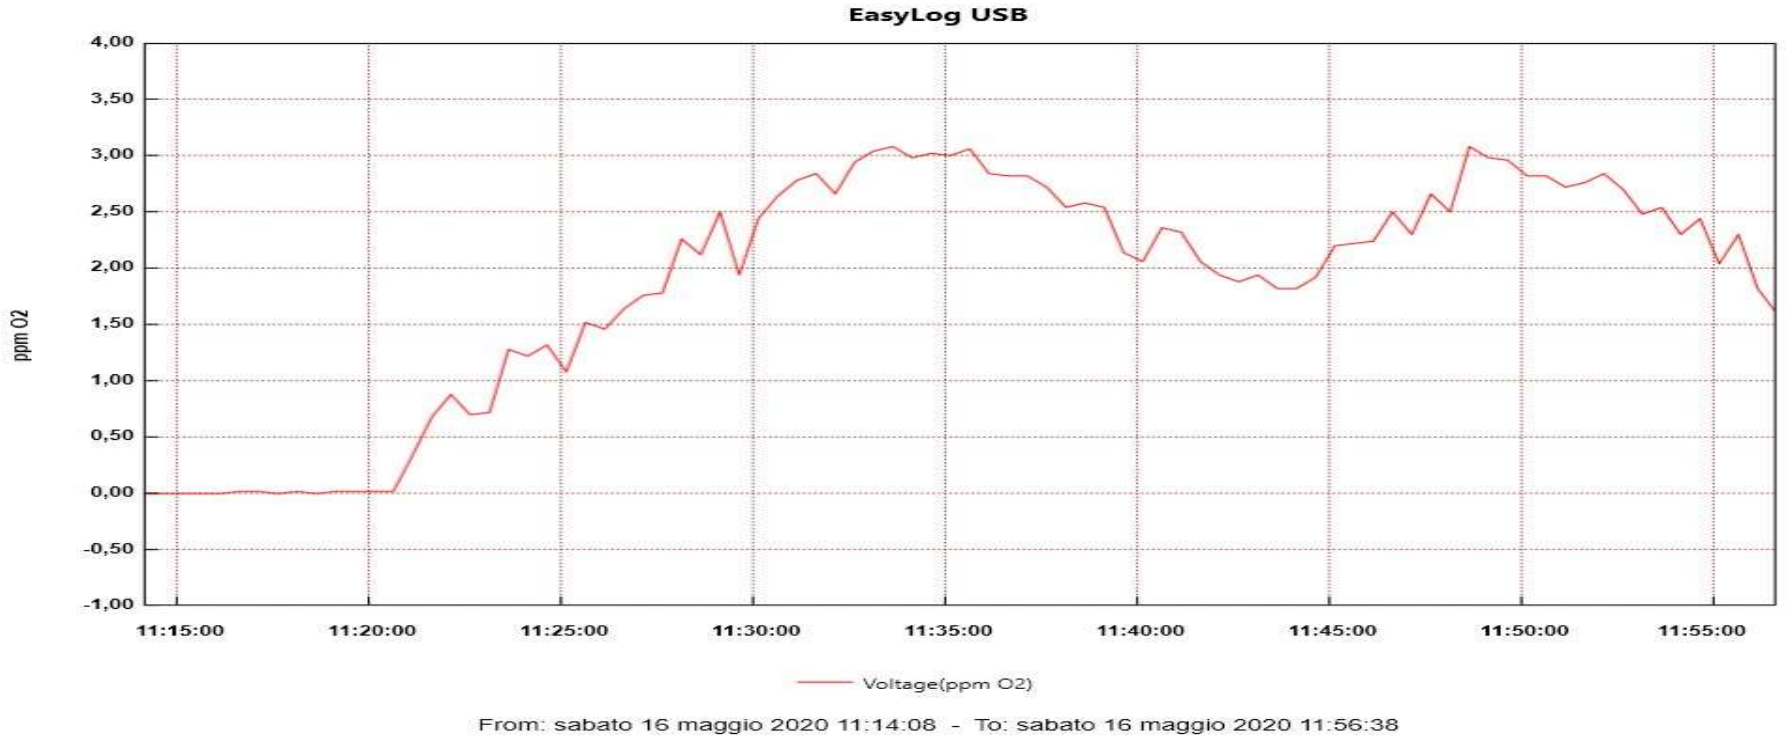

Camera 6

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading	11:14:08 16/05/2020	Alarm	*Not Set*
Last Reading	11:56:38 16/05/2020	Logging Rate	30 Seconds
Elapsed Time	42m, 30s		
Total Readings	86		

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 11:14:08 16/05/2020**	Alarm Occurrences N/A	Alarm Occurrences N/A
Maximum **3,08ppm O2 11:33:38 16/05/2020**	Total time in alarm N/A	Total time in alarm N/A
Average Reading **1,869ppm O2**	First Alarm Triggered N/A	First Alarm Triggered N/A
Standard Deviation **1,017ppm O2**	Longest Alarm N/A	Longest Alarm N/A

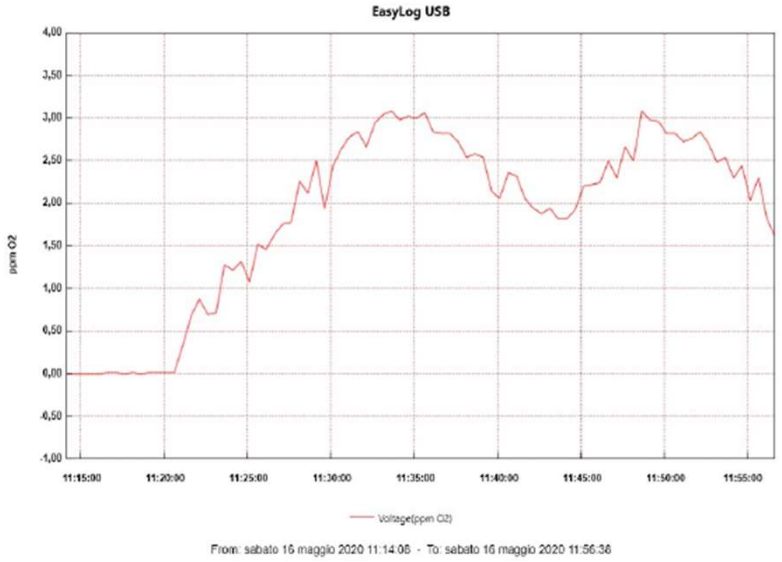

Camera 6

CONVENTO ACQUA PREMULA
15-16/05/2020

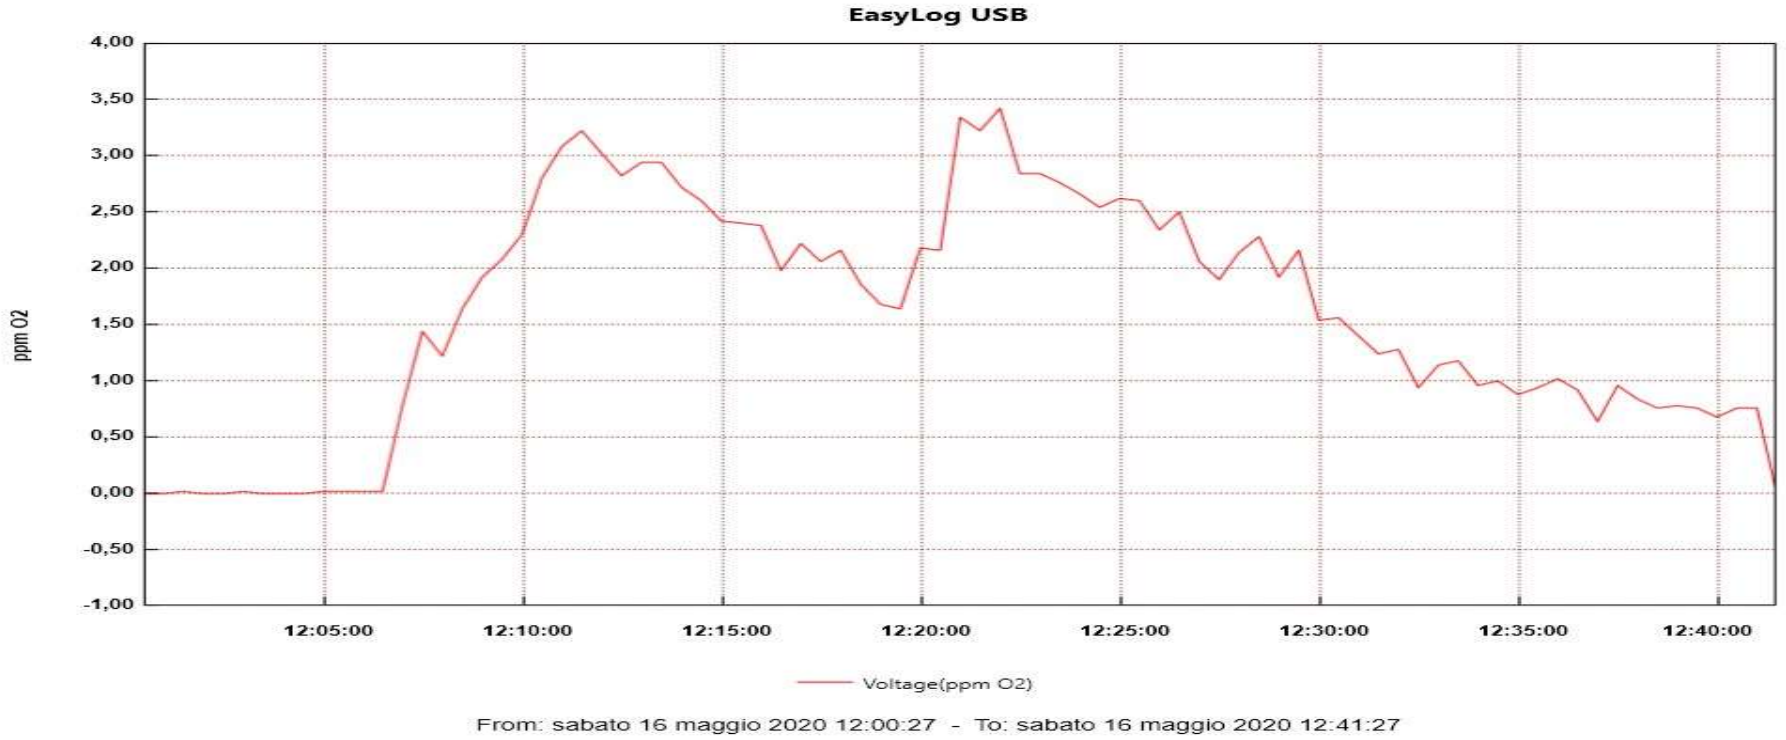

Camera 7

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 12:00:27 16/05/2020
Last Reading 12:41:27 16/05/2020
Elapsed Time 41m, 0s
Total Readings 83

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 12:00:27 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **3,42ppm O2 12:21:57 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,688ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **1,021ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

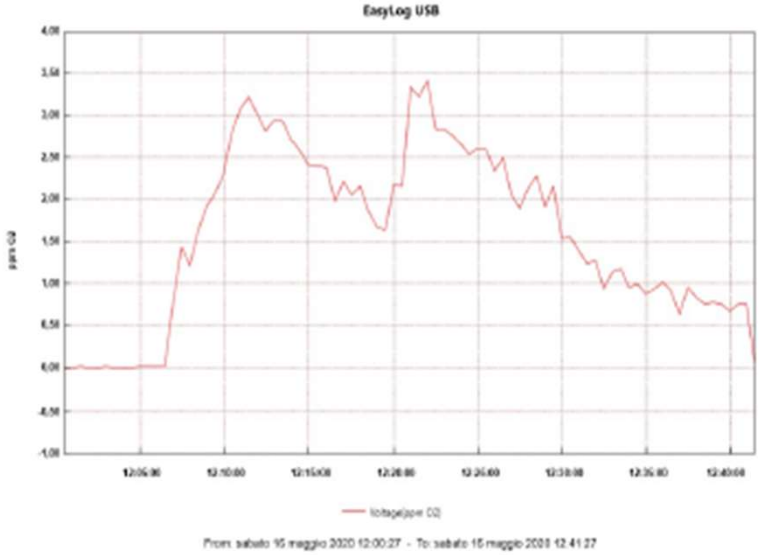

Camera 7

CONVENTO ACQUA PREMULA
15-16/05/2020

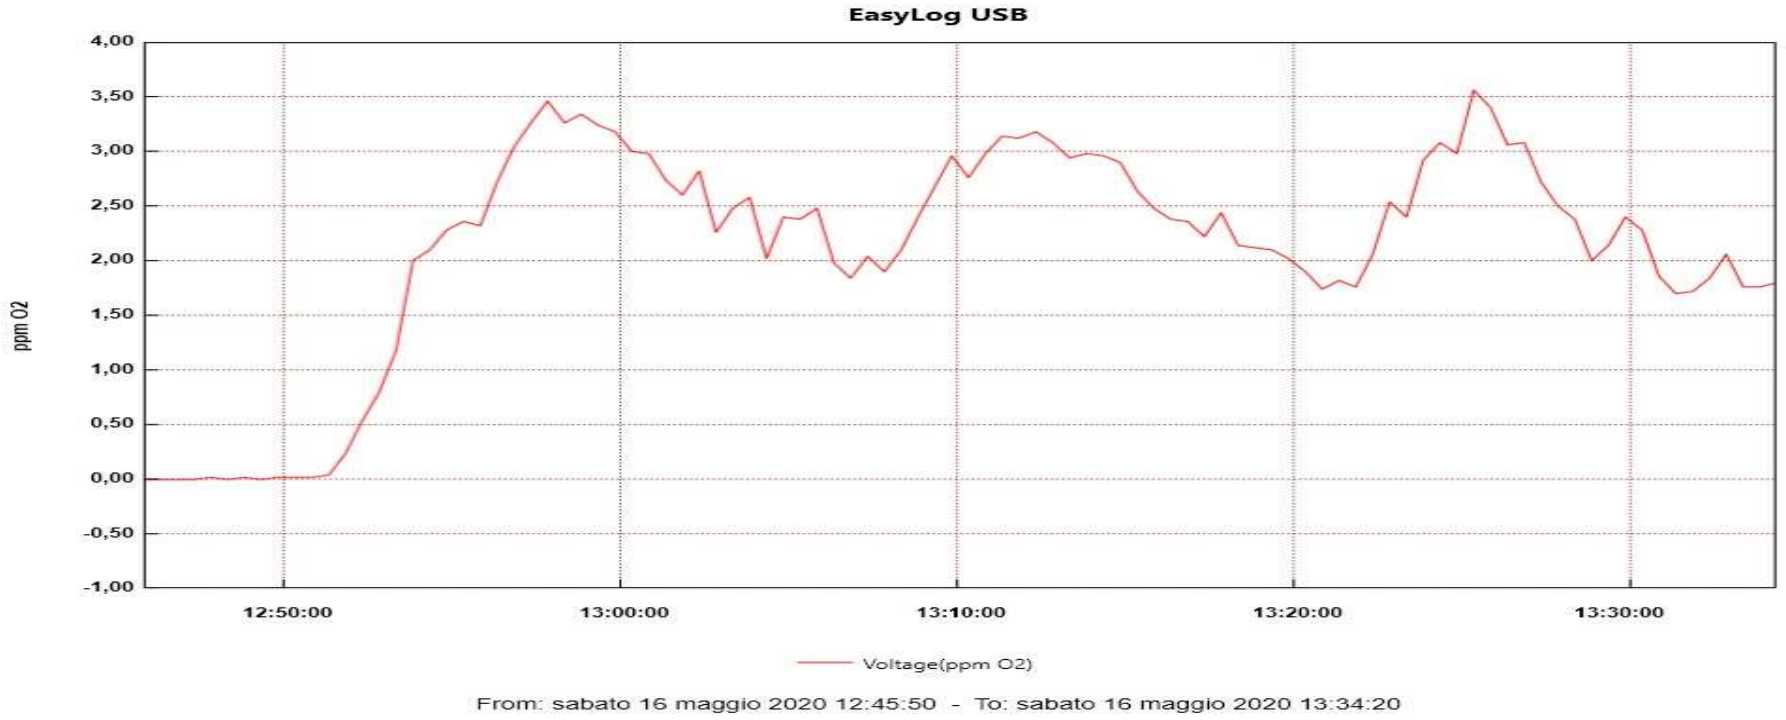

Camera 8

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading	12:45:50 16/05/2020	Alarm	Not Set
Last Reading	13:34:20 16/05/2020	Logging Rate	30 Seconds
Elapsed Time	48m, 30s		
Total Readings	98		

Voltage	Low Alarm Not Set	High Alarm Not Set
Minimum **0,00ppm O2 12:45:50 16/05/2020**	Alarm Occurrences N/A	Alarm Occurrences N/A
Maximum **3,68ppm O2 13:25:20 16/05/2020**	Total time in alarm N/A	Total time in alarm N/A
Average Reading **2,126ppm O2**	First Alarm Triggered N/A	First Alarm Triggered N/A
Standard Deviation **0,883ppm O2**	Longest Alarm N/A	Longest Alarm N/A

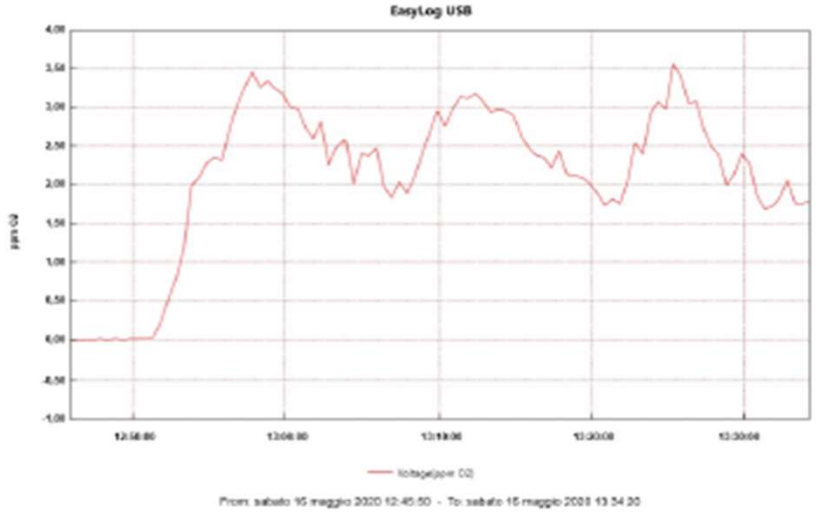

Camera 8

CONVENTO ACQUA PREMULA
15-16/05/2020

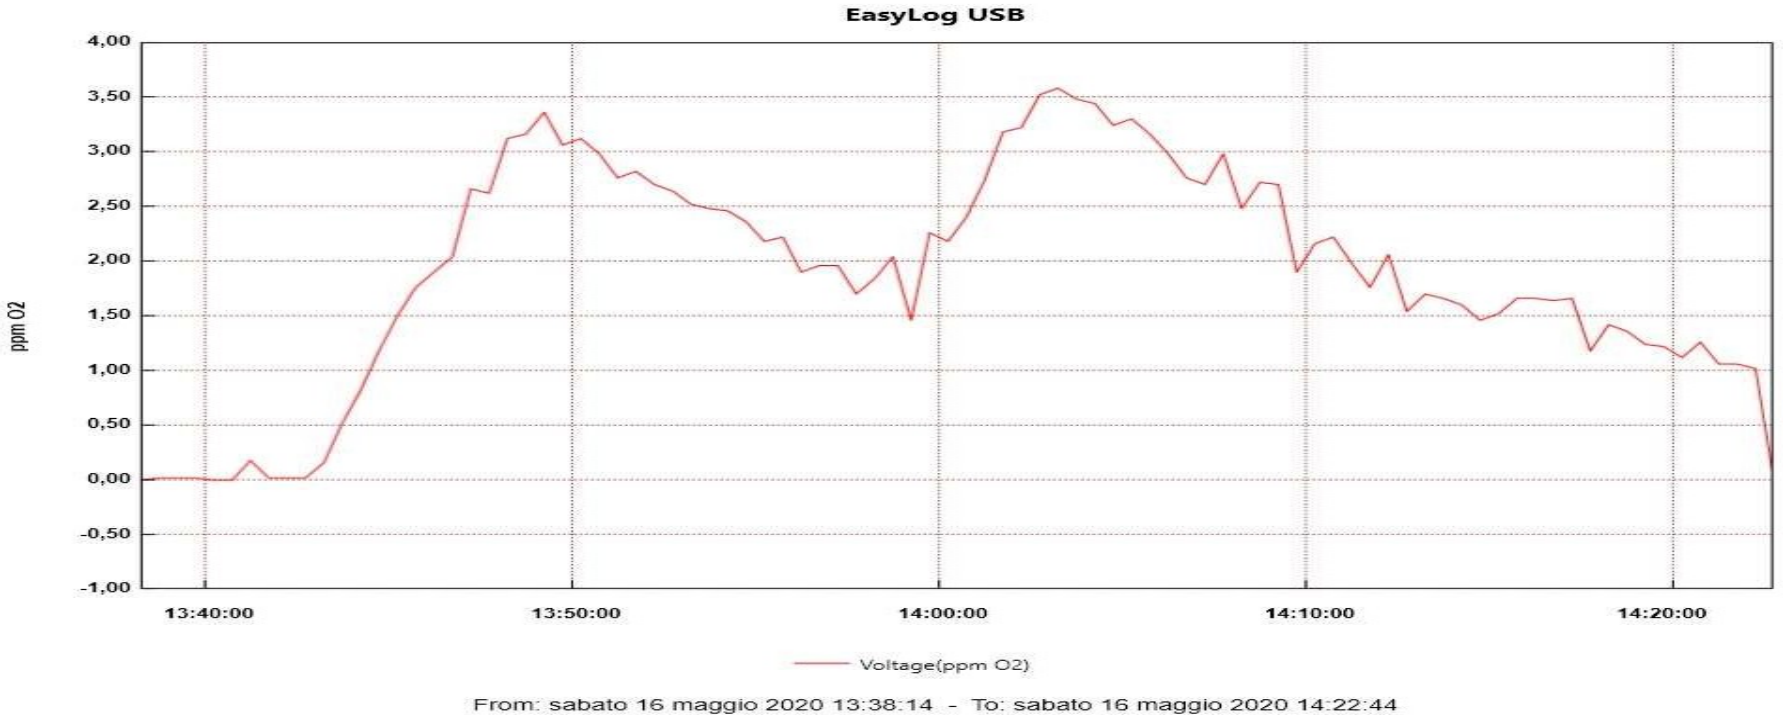

Camera 9

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 13:38:14 16/05/2020
Last Reading 14:22:44 16/05/2020
Elapsed Time 44m, 30s
Total Readings 90

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 13:38:14 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **3,68ppm O2 14:03:14 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,904ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **1,011ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

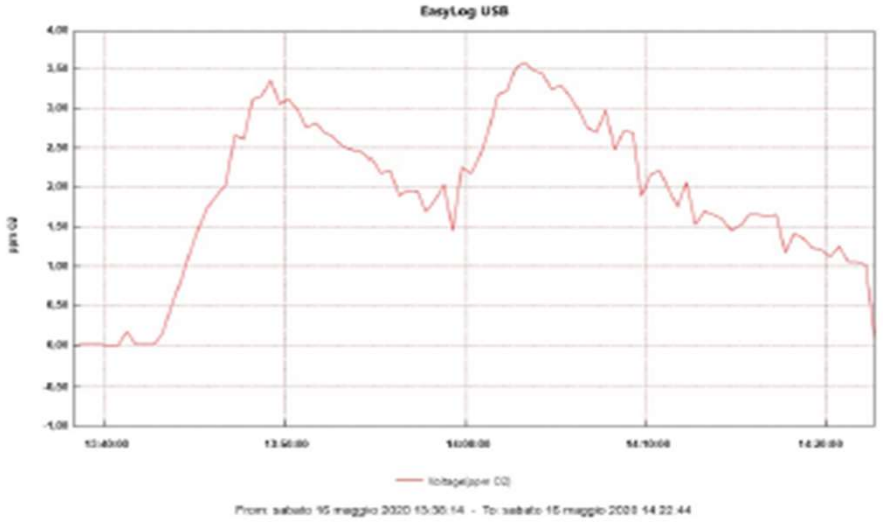

Camera 9

CONVENTO ACQUA PREMULA
15-16/05/2020

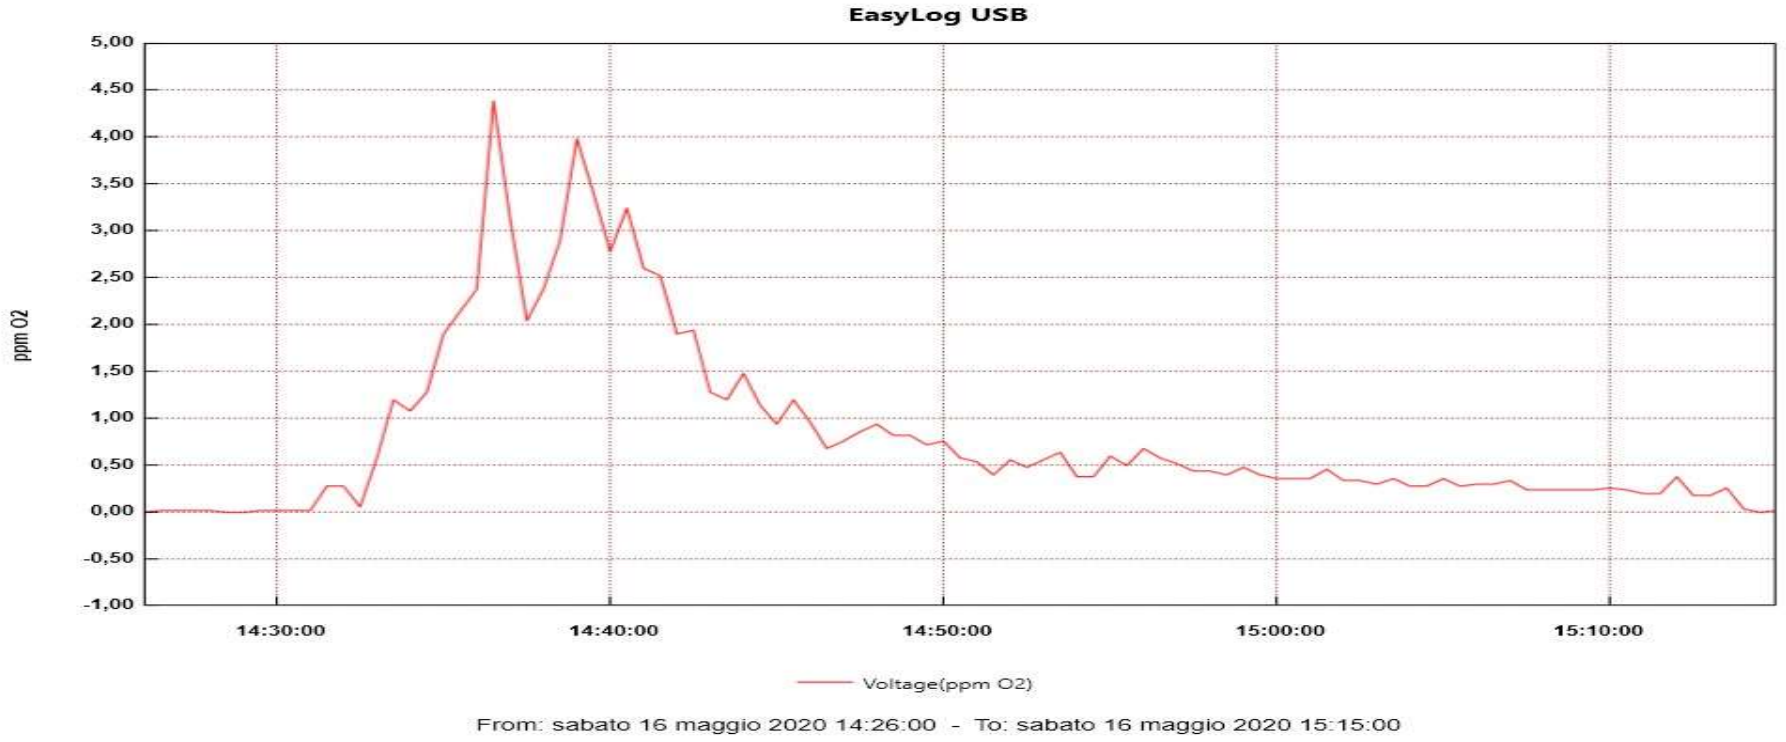

Camera 10

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 14:26:00 16/05/2020
Last Reading 15:15:00 16/05/2020
Elapsed Time 49m, 0s
Total Readings 99

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 14:26:00 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **4,38ppm O2 14:36:30 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **0,816ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,844ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

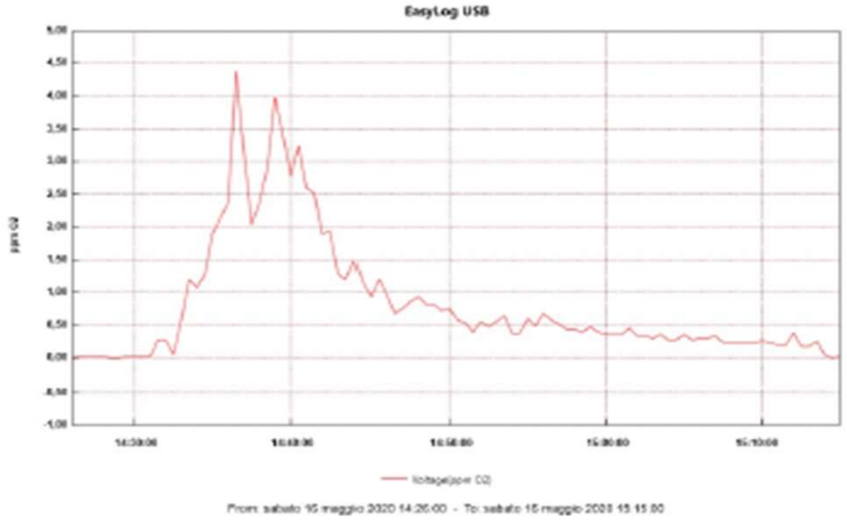

Camera 10

CONVENTO ACQUA PREMULA
15-16/05/2020

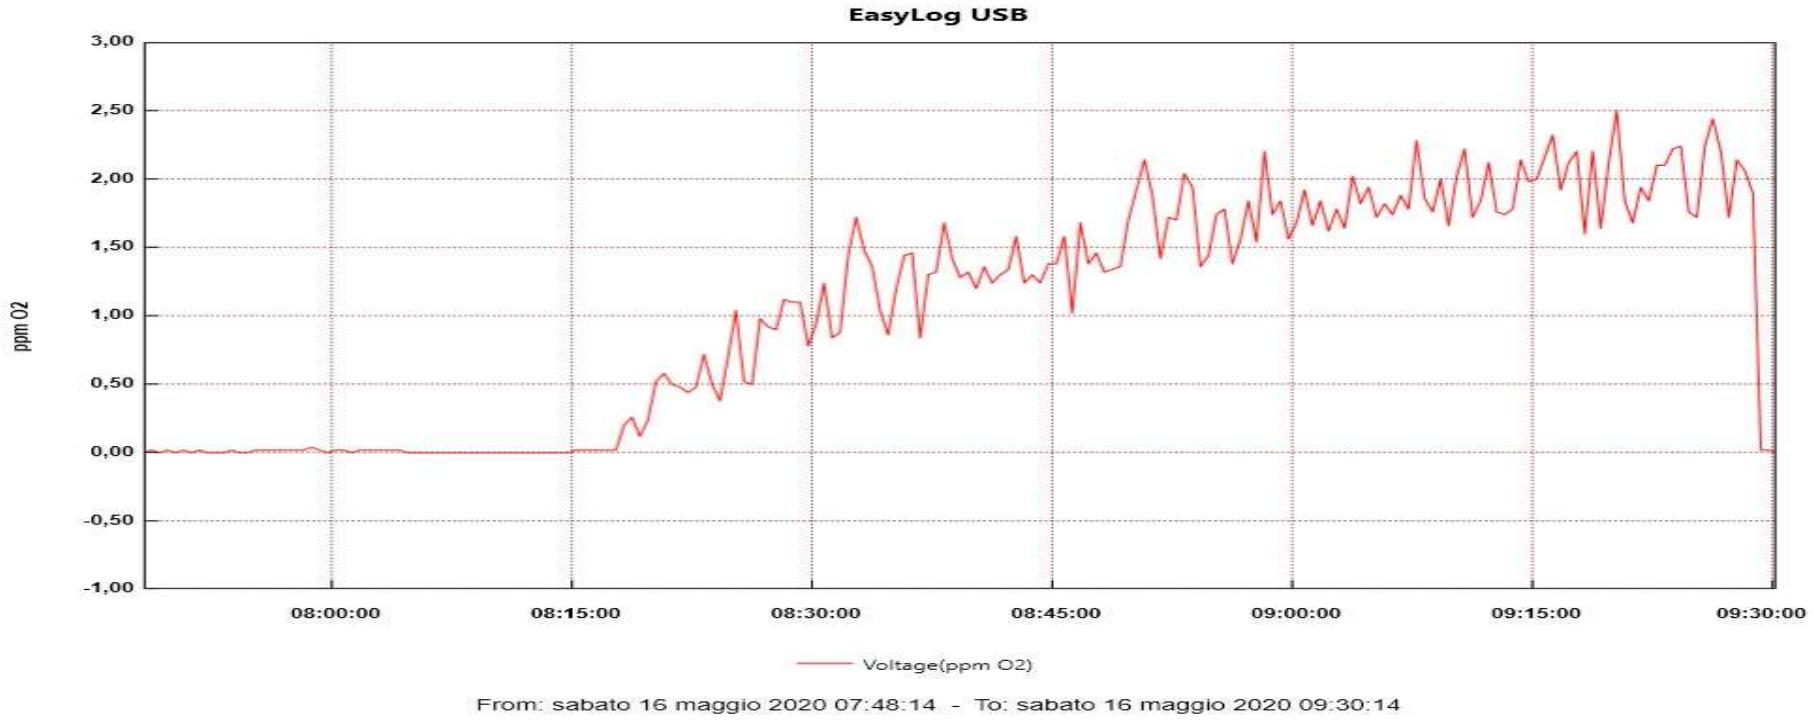

Camera 1-2-3

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 07:48:14 16/05/2020
Last Reading 09:30:14 16/05/2020
Elapsed Time 1h, 42m, 0s
Total Readings 205

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 07:48:14 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **2,60ppm O2 09:20:14 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,062ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,823ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

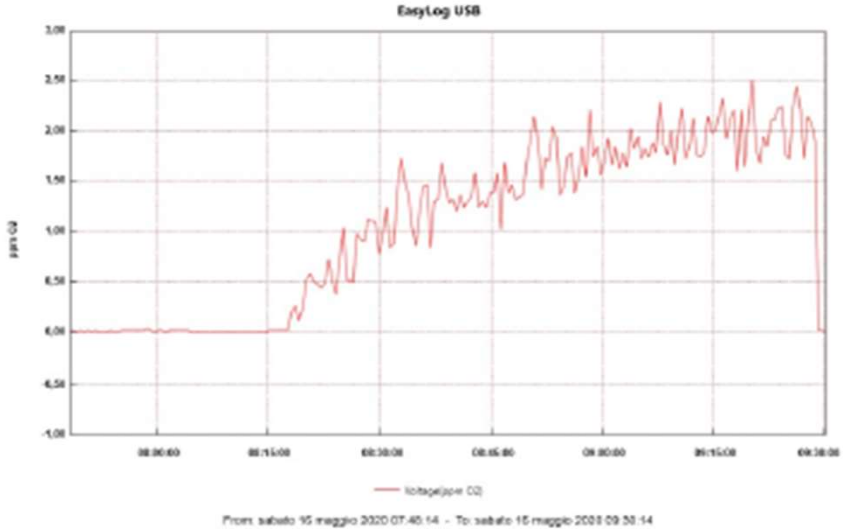

Camera 1-2-3

CONVENTO ACQUA PREMULA
15-16/05/2020

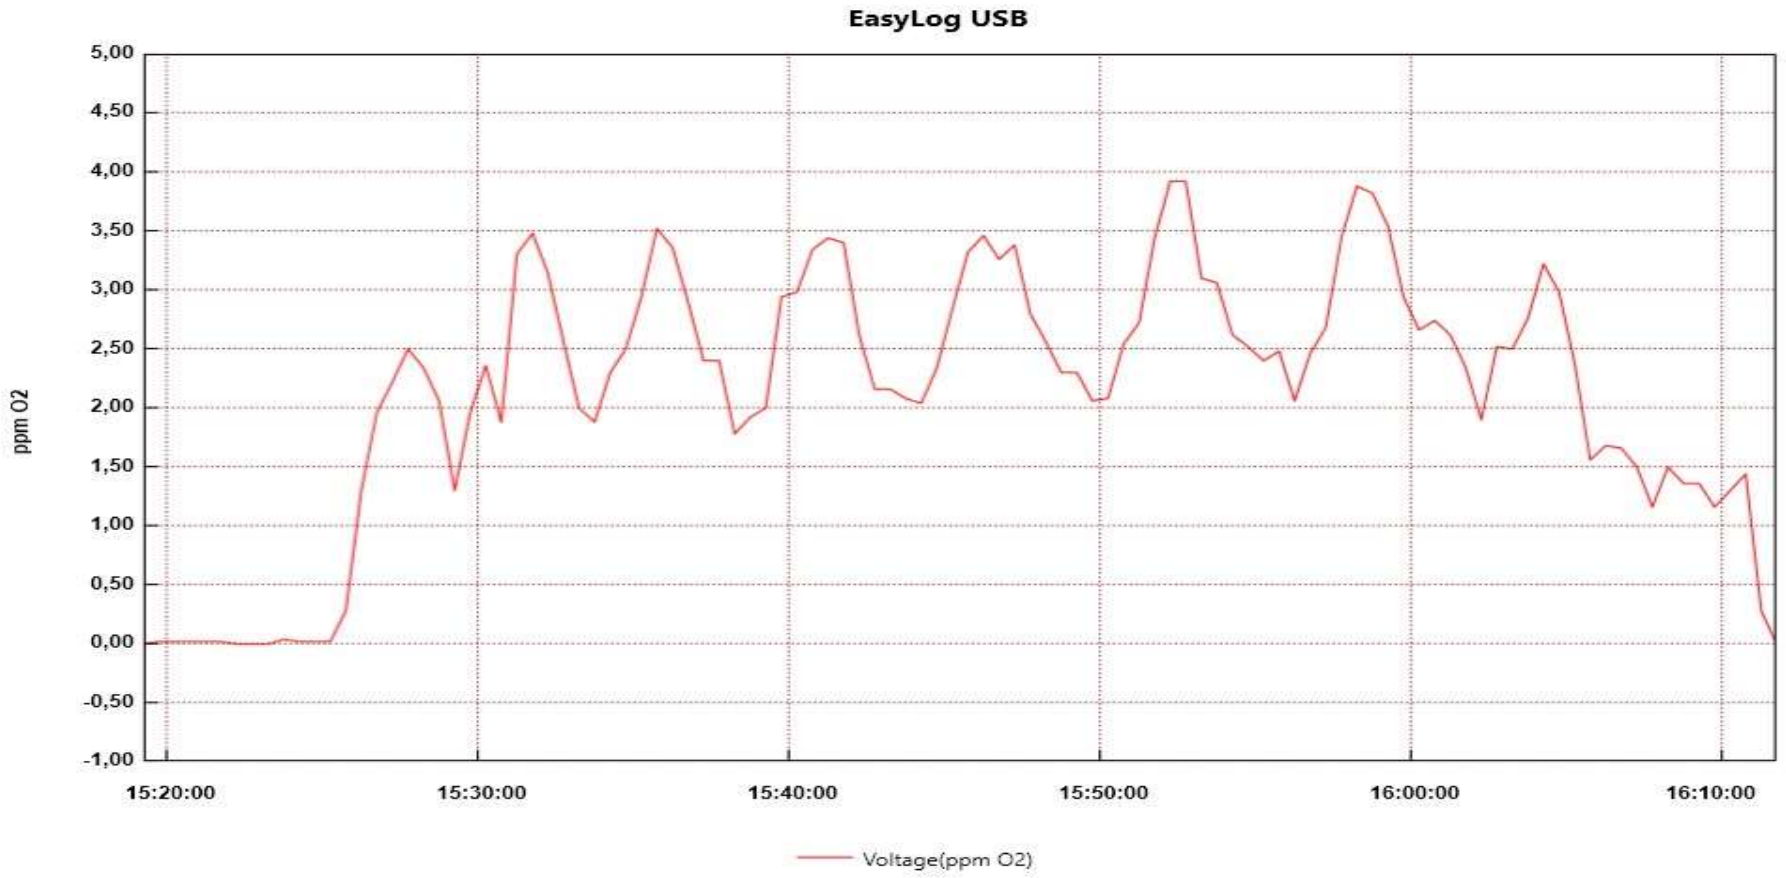

Corridoio camere 7-10

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading	15:19:15 16/05/2020	Alarm	Not Set
Last Reading	16:11:45 16/05/2020	Logging Rate	30 Seconds
Elapsed Time	52m, 30s		
Total Readings	106		

Voltage	Low Alarm Not Set	High Alarm Not Set
Minimum **0,00ppm O2 15:19:15 16/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **3,92ppm O2 15:52:15 16/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **2,138ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **1,088ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

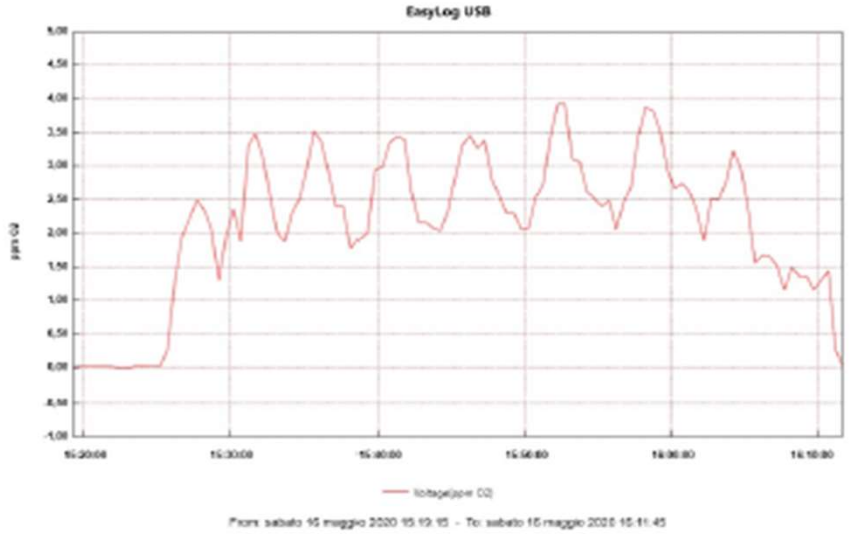

Corridoio camere 7-10

CONVENTO ACQUA PREMULA
15-16/05/2020

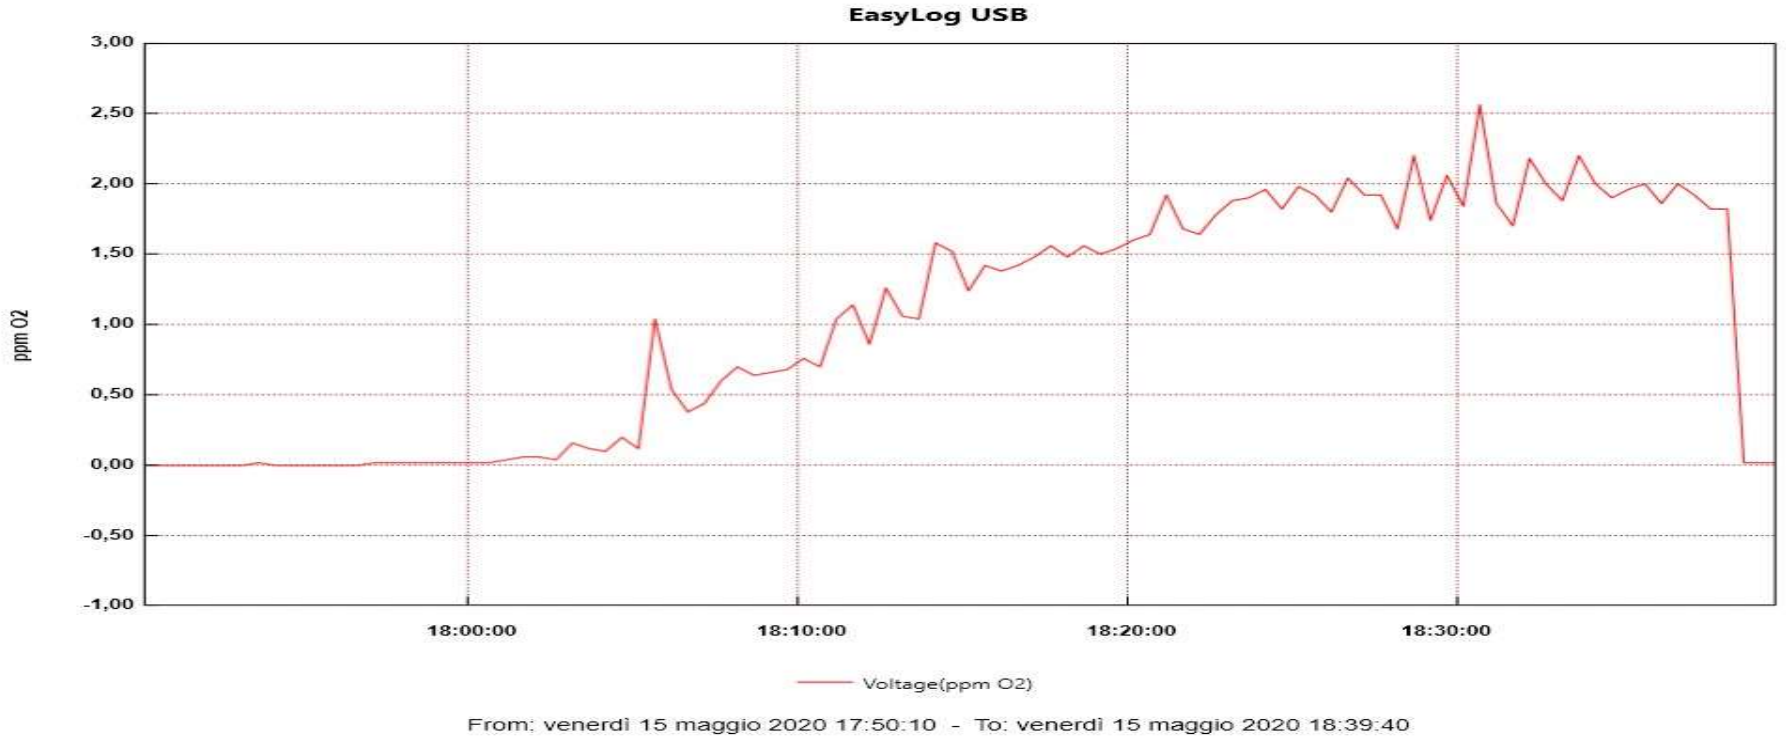

Cucina

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 17:50:10 15/05/2020
Last Reading 18:39:40 15/05/2020
Elapsed Time 49m, 30s
Total Readings 100

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 17:50:10 15/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **2,68ppm O2 18:30:40 15/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,028ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,826ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

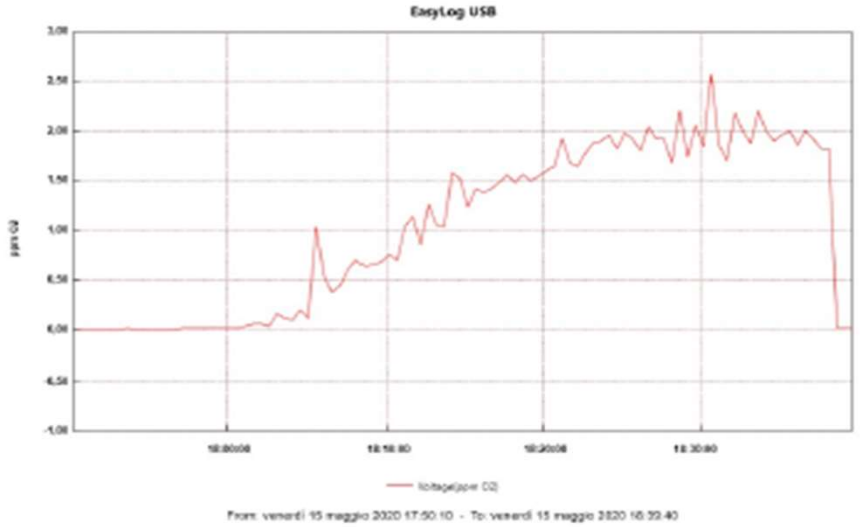

Cucina

CONVENTO ACQUA PREMULA
15-16/05/2020

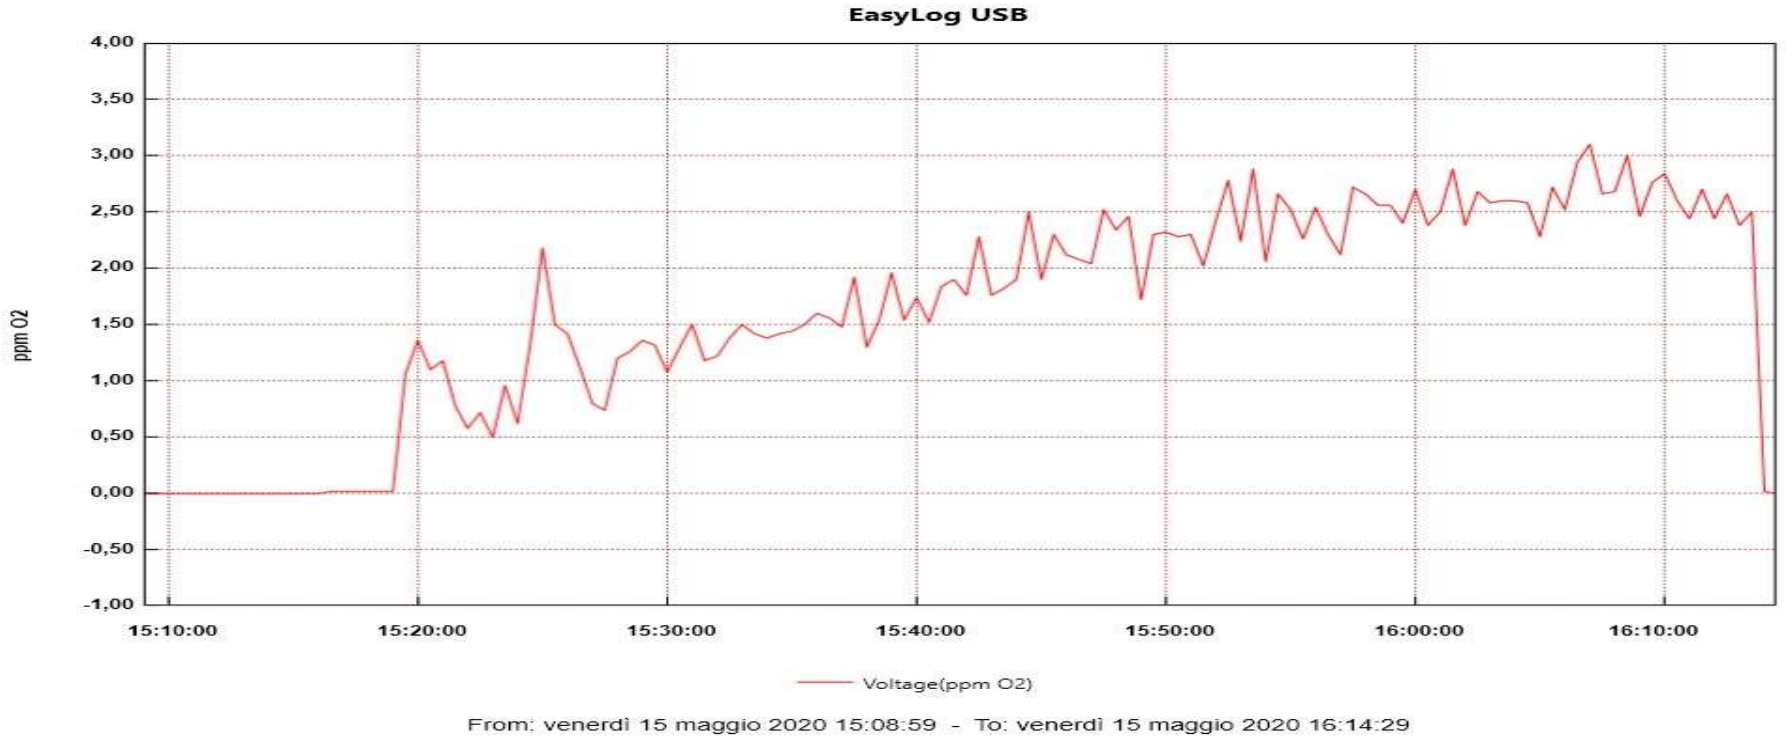

Hall

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 15:08:59 15/05/2020
Last Reading 16:14:29 15/05/2020
Elapsed Time 1h, 5m, 30s
Total Readings 132

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 15:08:59 15/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **3,10ppm O2 16:06:59 15/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **1,832ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,848ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

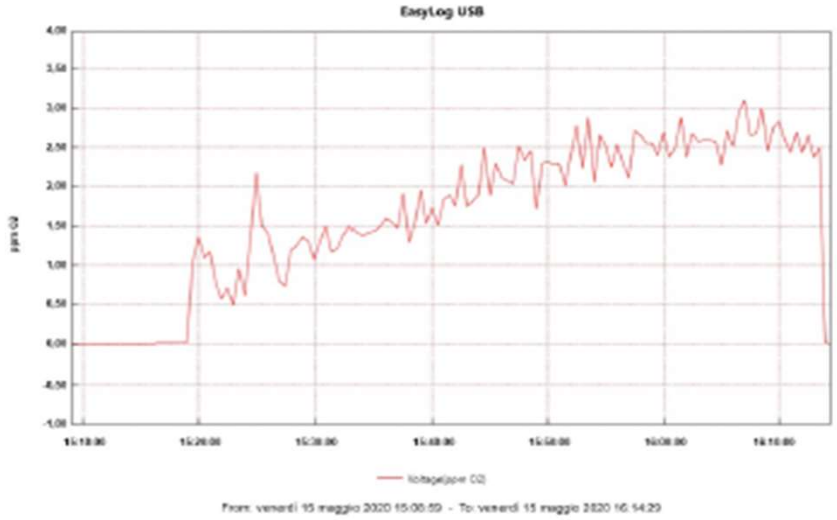

Hall

CONVENTO ACQUA PREMULA
15-16/05/2020

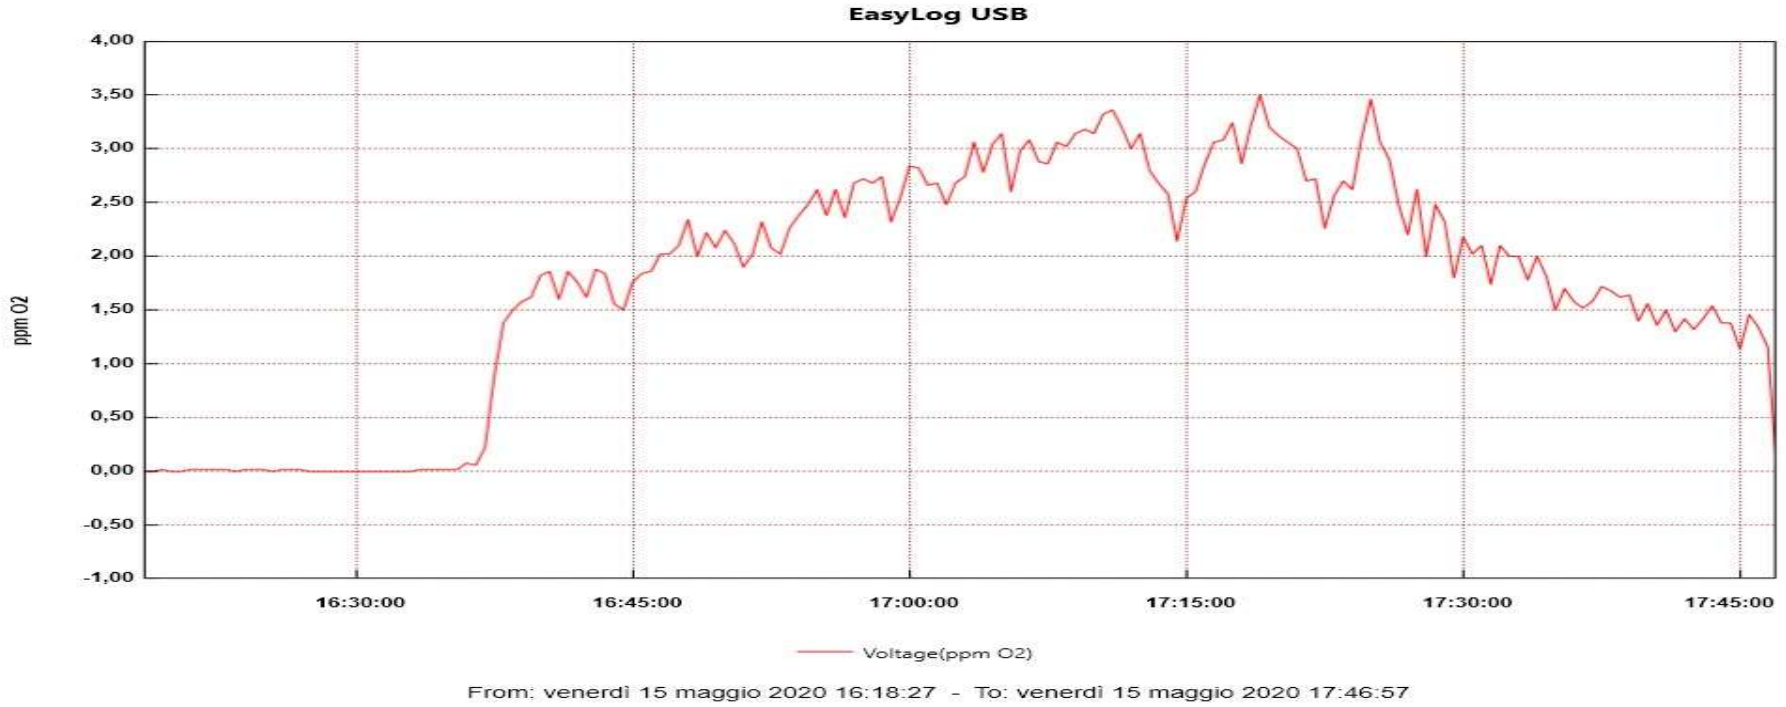

Sala camino

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading	16:18:27 15/05/2020	Alarm	*Not Set*
Last Reading	17:46:57 15/05/2020	Logging Rate	30 Seconds
Elapsed Time	1h, 28m, 30s		
Total Readings	178		

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 16:18:27 15/05/2020**	Alarm Occurrences N/A	Alarm Occurrences N/A
Maximum **3,60ppm O2 17:18:57 15/05/2020**	Total time in alarm N/A	Total time in alarm N/A
Average Reading **1,787ppm O2**	First Alarm Triggered N/A	First Alarm Triggered N/A
Standard Deviation **1,088ppm O2**	Longest Alarm N/A	Longest Alarm N/A

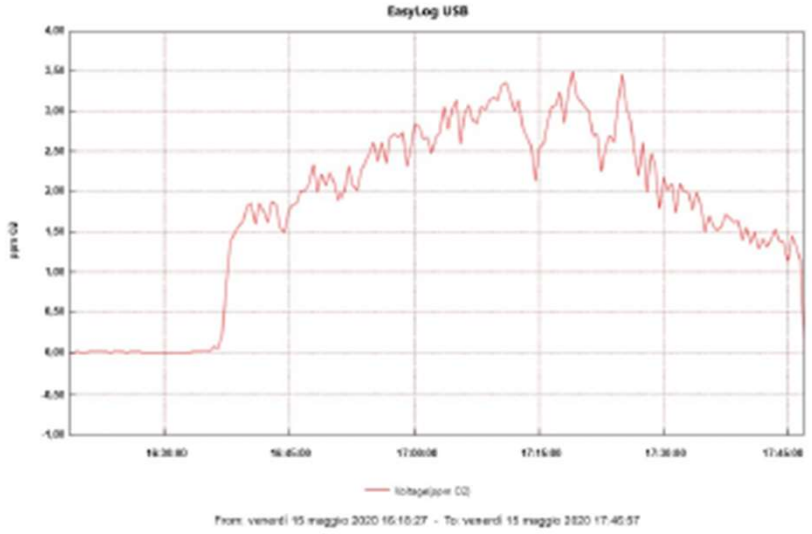

Sala camino

CONVENTO ACQUA PREMULA
15-16/05/2020

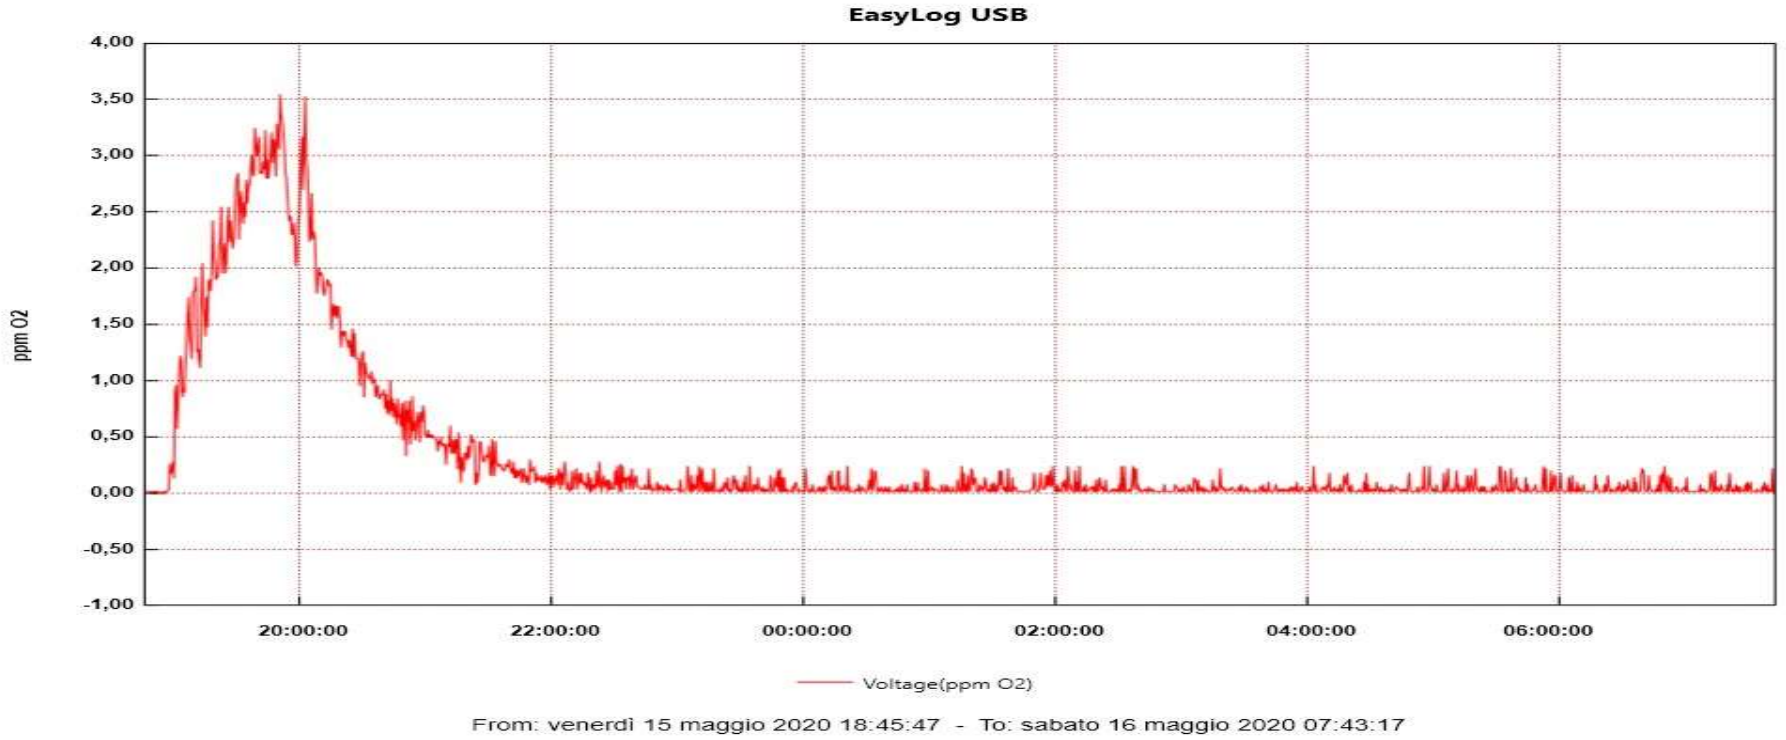

Sala ristorante

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading	18:45:47 15/05/2020	Alarm	*Not Set*
Last Reading	07:43:17 16/05/2020	Logging Rate	30 Seconds
Elapsed Time	12h, 57m, 30s		
Total Readings	1556		

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 18:45:47 15/05/2020**	Alarm Occurrences **N/A**	Alarm Occurrences **N/A**
Maximum **3,64ppm O2 19:50:47 15/05/2020**	Total time in alarm **N/A**	Total time in alarm **N/A**
Average Reading **0,340ppm O2**	First Alarm Triggered **N/A**	First Alarm Triggered **N/A**
Standard Deviation **0,706ppm O2**	Longest Alarm **N/A**	Longest Alarm **N/A**

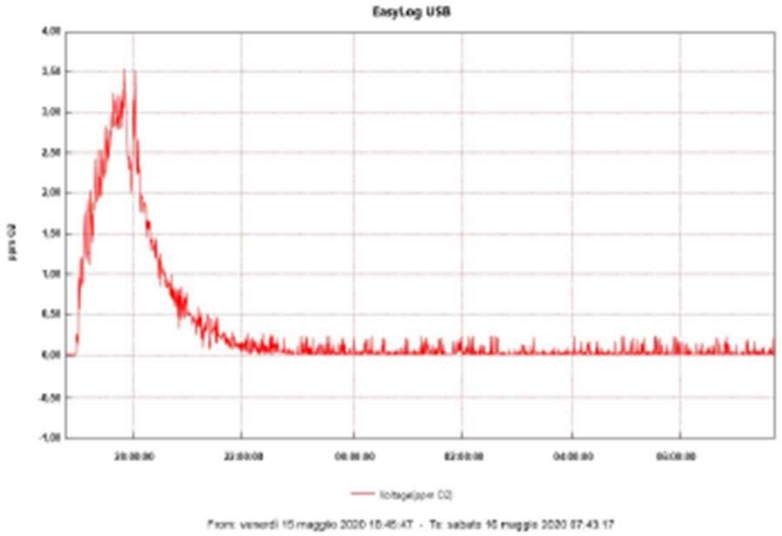

Sala ristorante

CONVENTO ACQUA PREMULA
15-16/05/2020

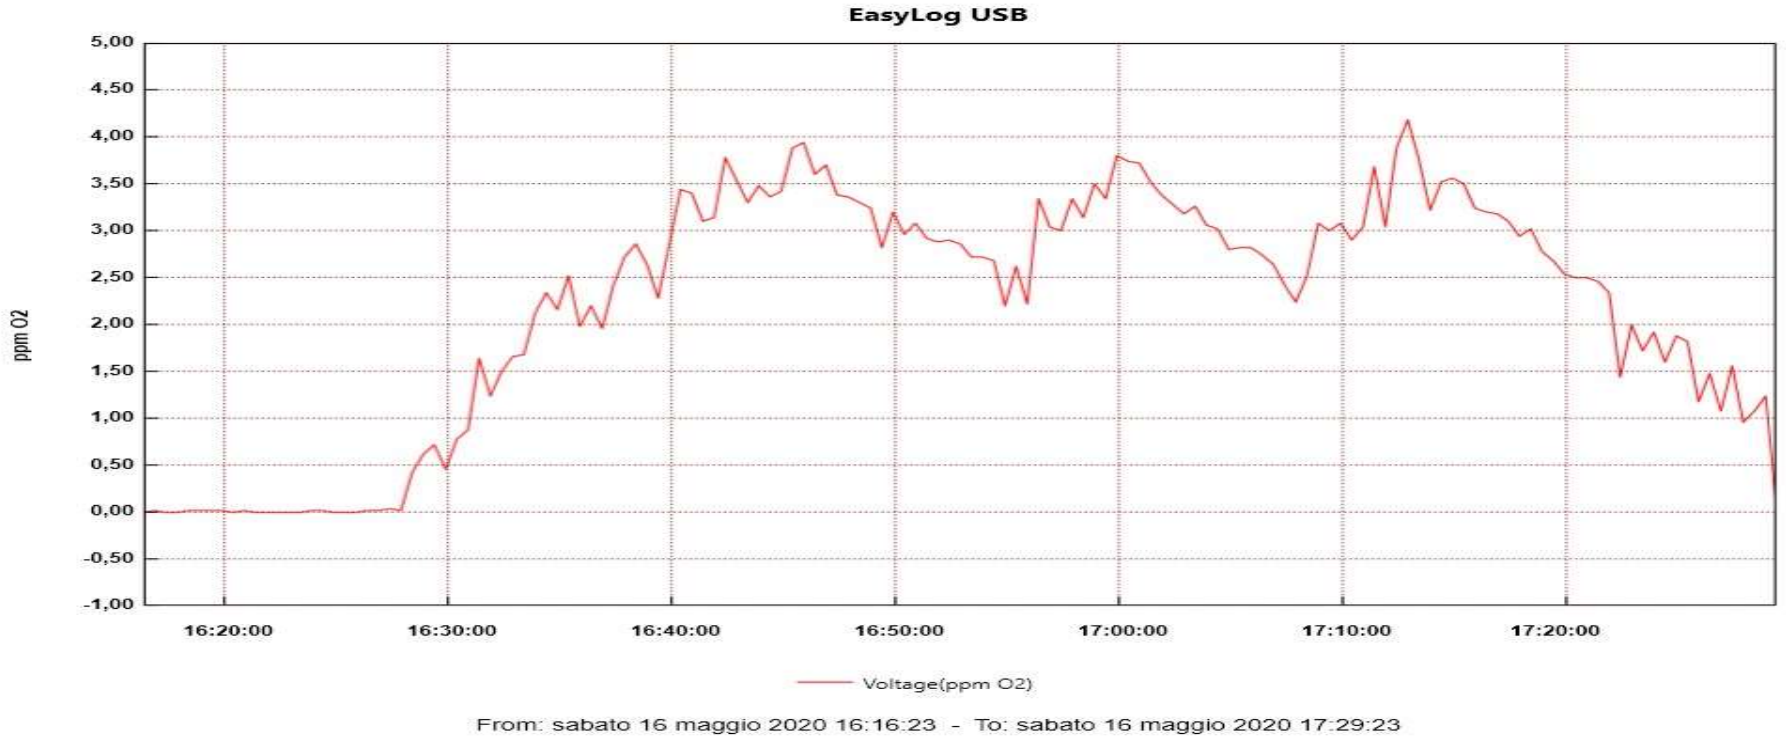

Scala camere

CONVENTO ACQUA PREMULA
15-16/05/2020

Summary Report

Serial Number 061002262
Logger Name EasyLog USB

First Reading 16:16:23 16/05/2020
Last Reading 17:29:23 16/05/2020
Elapsed Time 1h, 13m, 0s
Total Readings 147

Alarm *Not Set*
Logging Rate 30 Seconds

Voltage	Low Alarm *Not Set*	High Alarm *Not Set*
Minimum **0,00ppm O2 16:16:23 16/05/2020**	Alarm Occurrences N/A	Alarm Occurrences N/A
Maximum **4,18ppm O2 17:12:53 16/05/2020**	Total time in alarm N/A	Total time in alarm N/A
Average Reading **2,222ppm O2**	First Alarm Triggered N/A	First Alarm Triggered N/A
Standard Deviation **1,283ppm O2**	Longest Alarm N/A	Longest Alarm N/A

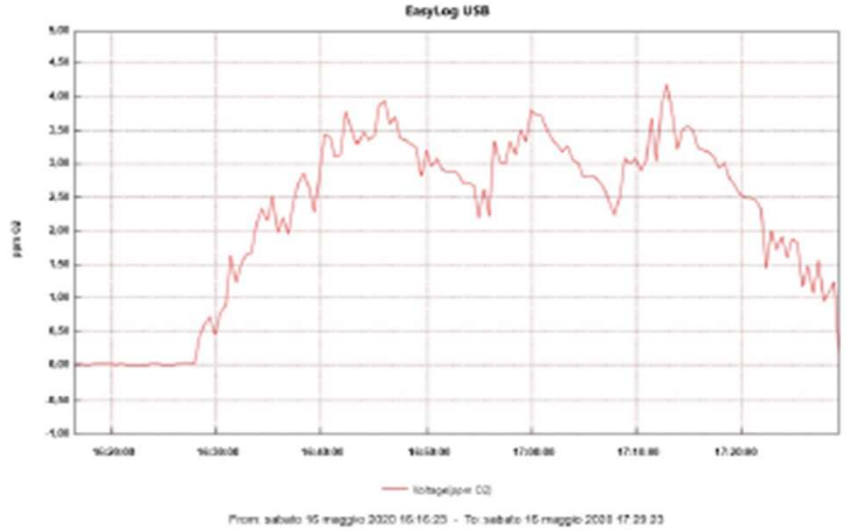

Scala camere

CONVENTO ACQUA PREMULA
15-16/05/2020

LA LUCENTE S.R.L.
IMPRESA PULIZIA
Via dei Papaveri, 8
Tel. 0743.49295
Fax 0743.46283
06049 Eggi di Spoleto (Pg)
Cap. Soc. € 10.330,00
Sede legale: Eggi di Spoleto - Tribunale Spoleto n. 1276
C.C.I.A.A. Perugia N. 142845 - C.F. e P.I. 01512990548

Oggetto: dichiarazione corretta esecuzione sanificazione

Il sottoscritto GERLI MARIA ROSA nata a MASSA MARTANA IL 31/01/1951 in qualità di legale rappresentante dell'impresa di pulizie La Lucente srl, con sede legale in Via dei Papaveri, n.8 P.IVA. in riferimento all'incarico ricevuto

DICHIARA

di aver correttamente eseguito presso i locali del Convento Acqua Premula in Localita Cappuccini a Sellano (PG), *un ciclo di sanificazione ambientale con ozonizzatore Mod. Medical Room (n. di serie 300216.1228) come da Report Allegato.*

In fede

Spoleto, 18/05/2020

LA LUCENTE SRL
IMPRESA DI PULIZIA

Il legale rappresentante

CONVENTO ACQUA PREMULA
15-16/05/2020